



© Firetrol, Inc. Not for construction.
Subject to change without notice.

| | | |
|----------------|-----|----------|
| BY | | DD/MM/YY |
| DRAWN BY | MLC | 04/10/24 |
| FINAL APPROVAL | FC | 07/11/24 |

ELECTRIC FIRE PUMP CONTROLLER WITH AUTOMATIC TRANSFER SWITCH

MODEL:FTA1000/FTA1250/FTA1300




BUILT TO THE LATEST EDITION OF THE NFPA20 & NFPA70



THIRD ANGLE
PROJECTION

| | |
|----------------|--------------|
| DRAWING NUMBER | DD1000-934/E |
| DWG REV. 0 | |
| SHEET 1 OF 1 | |

| Voltage / Power Table | | |
|-----------------------|--------|--------|
| Voltage | Min HP | Max HP |
| 208 | 150 | |
| 220 - 240 | 150 | 200 |
| 380 - 400 - 415 | 250 | 300 |
| 440 - 480 | 300 | 350 |
| 600 | 400 | 500 |

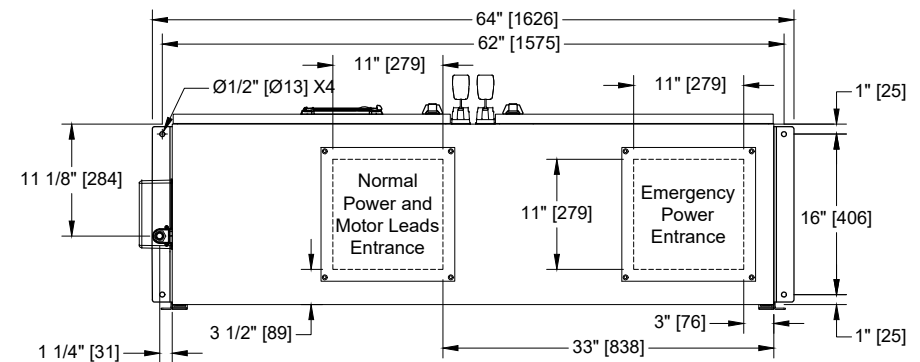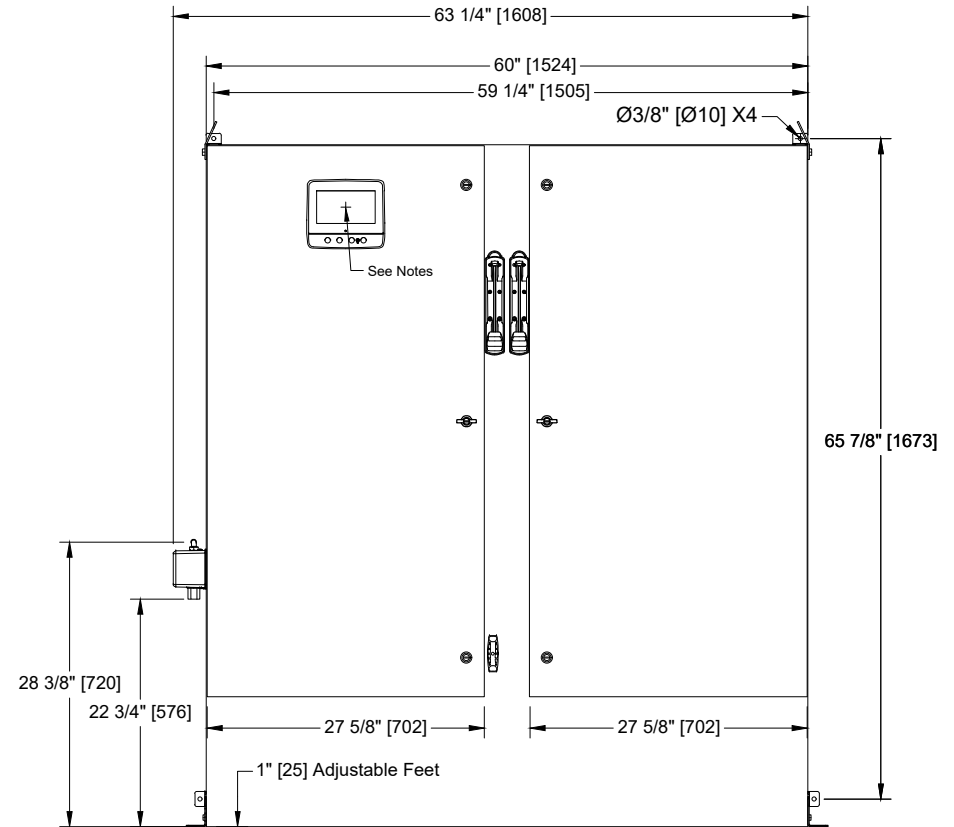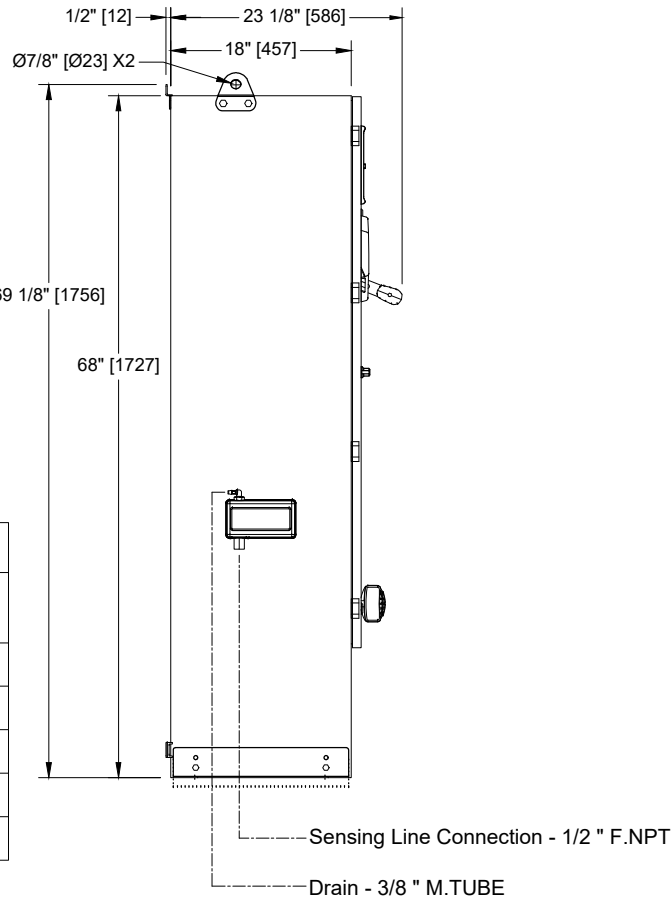

Notes:

- Standard NEMA: NEMA 2
- Standard paint : textured red RAL 3002.
- All dimensions are in inches [millimeters].
- Center of screen: 61-5/8" [1564] from bottom.
- Bottom conduit entrance through removable gland plate recommended.
- Use watertight conduit and connector only.
- Protect equipment against drilling chips.
- Door swing equal to door width.