



MarkIIxG Electric Fire Pump Controllers - Variable Speed Starting with Autotransformer Bypass

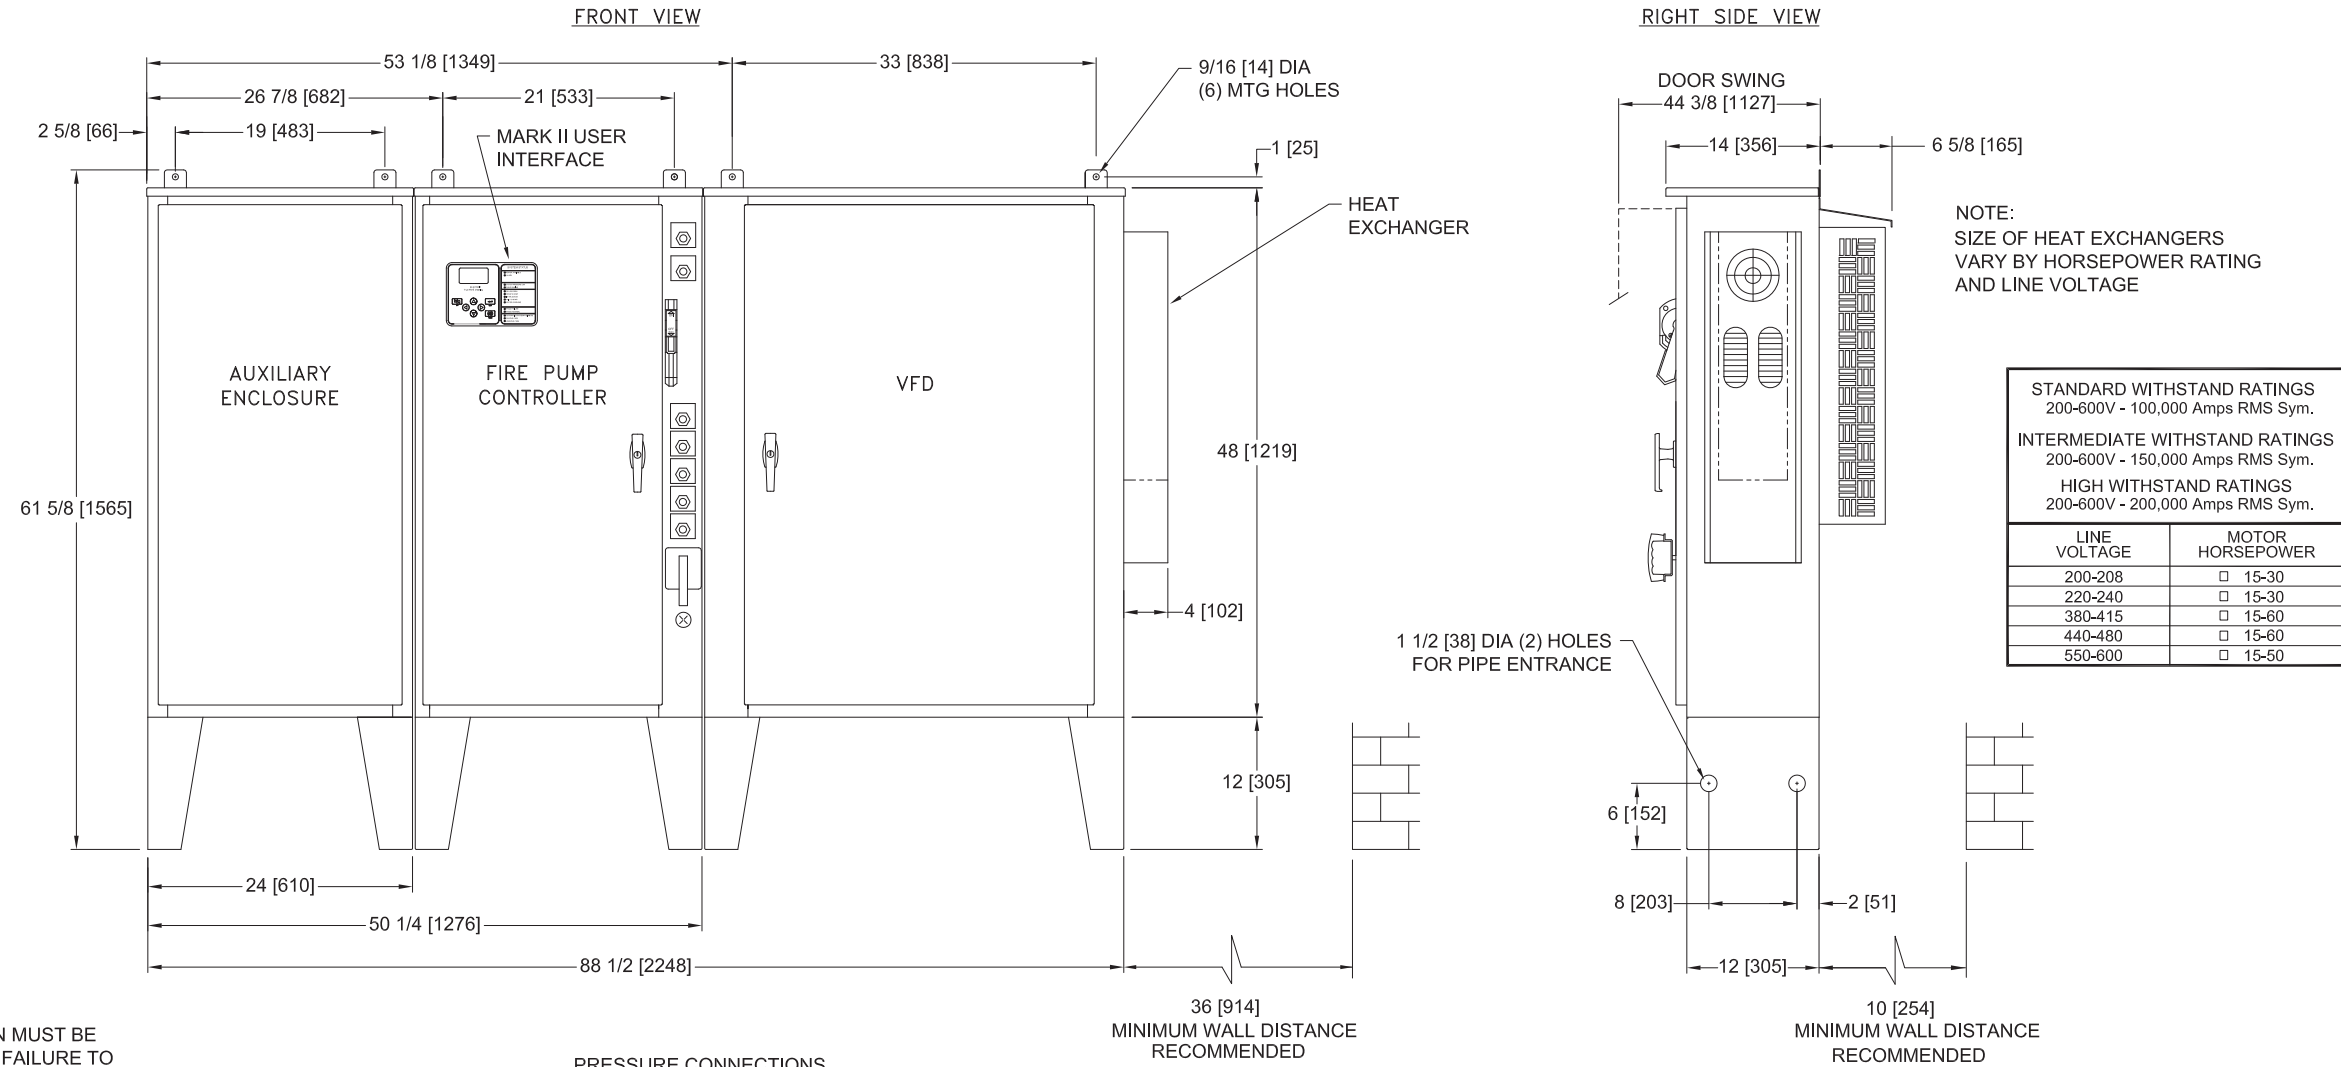

NOTE:
TEST DRAIN CONNECTION MUST BE PIPED TO WASTE DRAIN. FAILURE TO CONNECT TO A FLOOR DRAIN WILL RESULT IN UNSAFE CONDITIONS OF STANDING WATER AROUND CONTROLLER

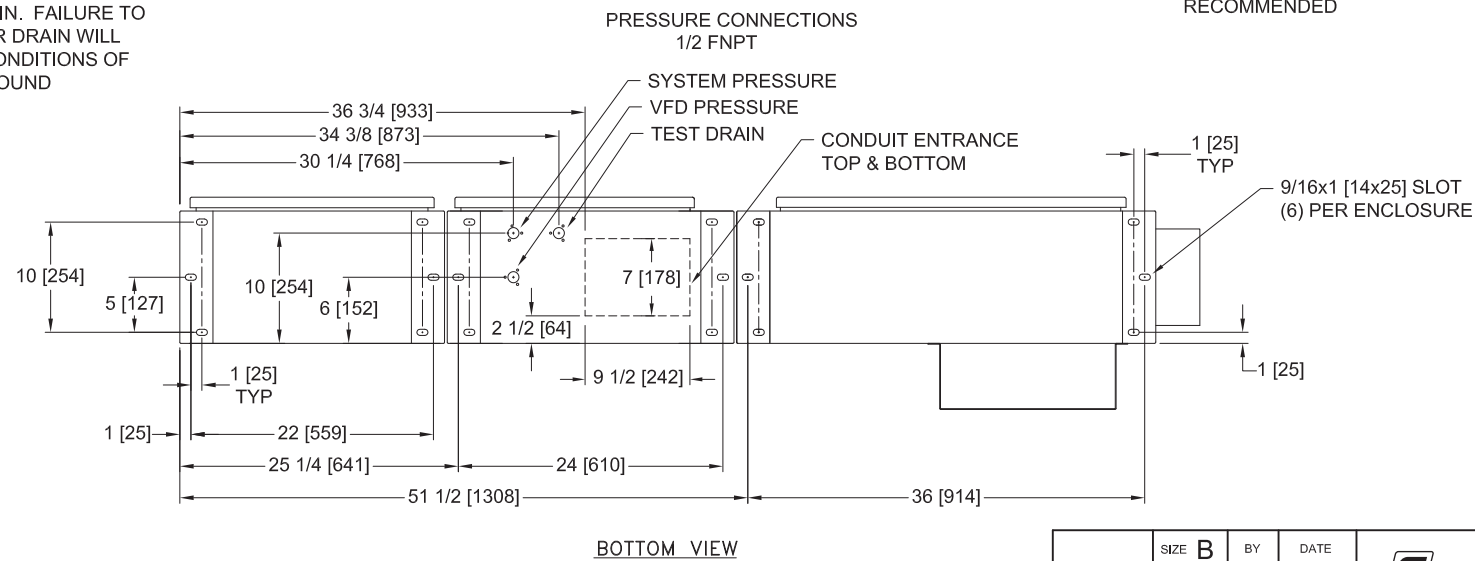

- NOTES:**
- DO NOT INSTALL IN AMBIENT TEMPERATURES ABOVE 40°C [104°F] OR BELOW 5°C [41°F]
 - ALL DIMENSIONS IN INCHES [MM]
 - FOR HORSEPOWER OR WITHSTAND RATINGS NOT LISTED IN THIS TABLE, REFER TO ED3110M-01
 - DRAWINGS USED FOR CONSTRUCTION PURPOSES MUST BE OBTAINED FROM FIRETROL OR THE LOCAL FIRETROL REPRESENTATIVE
 - ALL CONTROLLERS TO BE A MINIMUM NEMA TYPE 12

THIRD ANGLE PROJECTION	SIZE	B	BY	DATE
	DRAWN BY	JMW	5-8-19	
	FINAL APPROVAL	CIR	5-8-19	



RELEASED	-	276990	JMW	CIR	5-8-19
REVISION DESCRIPTION	REV	ECN NO	BY	APP	DATE
ENCLOSURE DIMENSIONS	FTA3110M				
VFD ELECTRIC FIRE PUMP CONTROLLER WITH AUTOTRANSFORMER BYPASS	DRAWING NUMBER DD-3110M-01				
DWG REV	-	ECN NO	276990	SHEET 1 OF 1	