


Marklixe Electric Fire Pump Controllers - Variable Speed Starting with Autotransformer Bypass

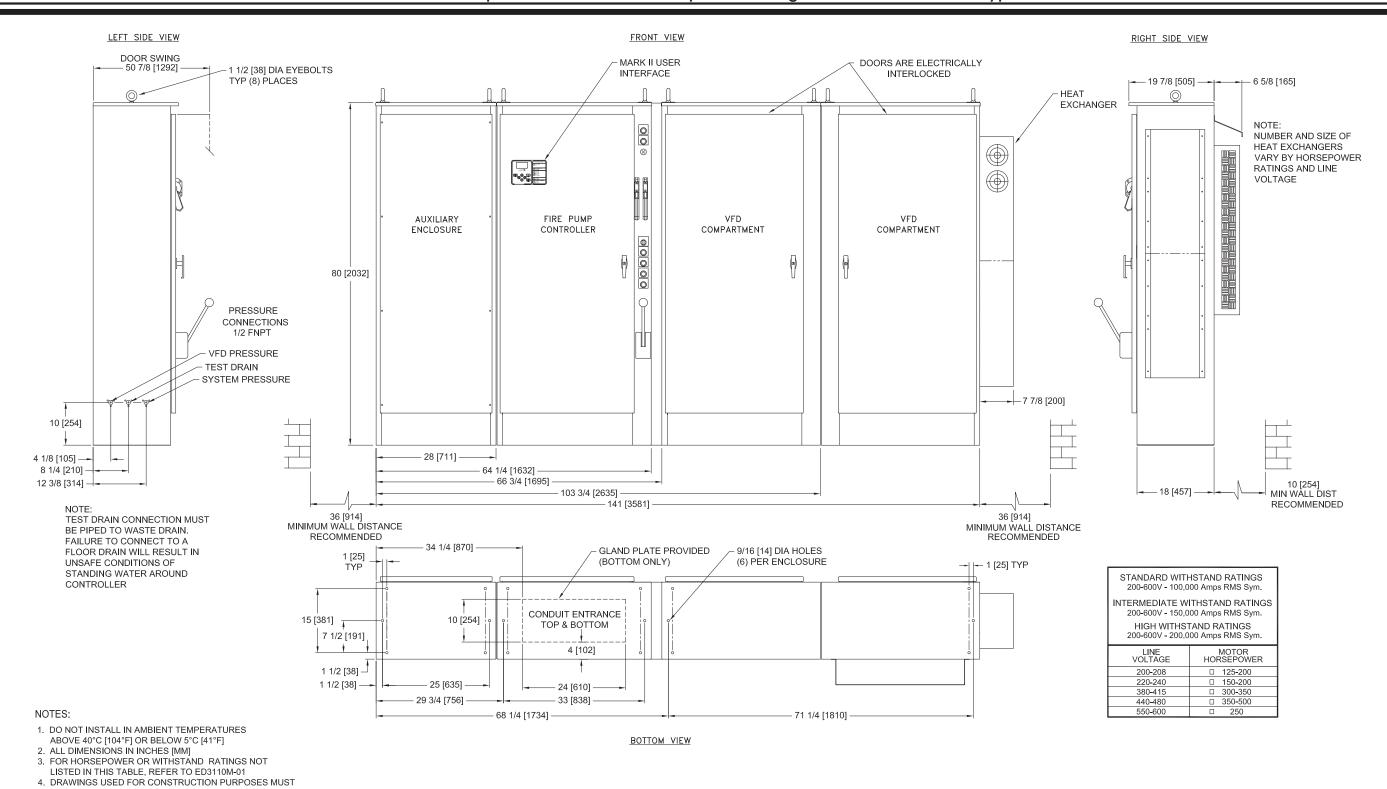

REPRESENTATIVE 5. ALL CONTROLLERS TO BE A MINIMUM NEMA TYPE 12 6. VFD COMPARTMENT SECTION IS SHIPPED SEPARATELY FROM FIRE PUMP COMPARTMENT SECTION

BE OBTAINED FROM FIRETROL OR THE LOCAL FIRETROL

RELEASED						-	276990	JMW	CIR	5-8-19	
THIRD ANGLE PROJECTION	SIZE B	BY	DATE	F Firetrol, Inc.	REVISION DESCRIPTION		REV	ECN NO	BY	APP	DATE
	DRAWN BY	JMW	5-8-19		ENCLOSURE DIMENSIONS	FTA3110M	DRAWING NUMBER				
							DD-3110M-05				
					VFD ELECTRIC FIRE PUMP CONTROLLER WITH AUTOTRANSFORMER BYPASS		DD 0110W 00				
	F IN AL APPROVAL	CIR	5-8-19	© Firetroi, Inc. Not for construction.			DWG REV -	ECN 27	6990	SH	IEET 1 OF 1
All rights reserved. The drawing and the Information contained or depicted herein are the sole property of Firetol, Inc. Copies are communicated to the recipient in strict confidence and may not be retransmitted, published, reproduced, oppied or used in any manor, including as the basis for the manufacture or sale of any products, without the express prior written consent of Fletrol, Inc.											