



MARK^{III} Medium Voltage Electric Fire Pump Controllers – Across The Line Starting

Remote Alarm Terminals (I/O board)

Terminals Wire Size:
24 - 12 AWG
0.5 Nm

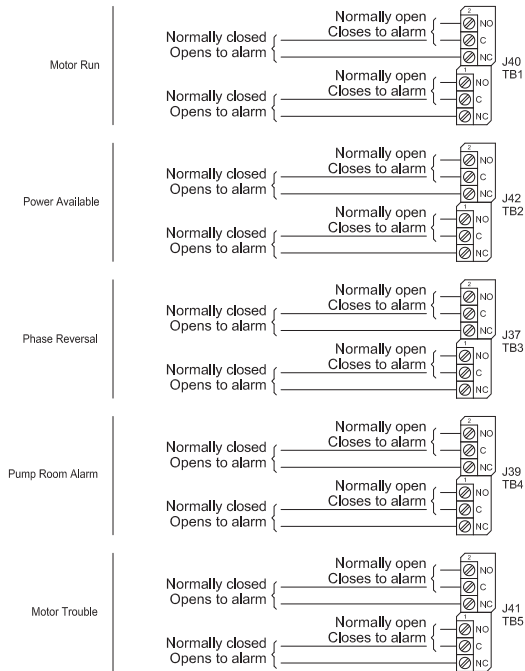

Power Terminals

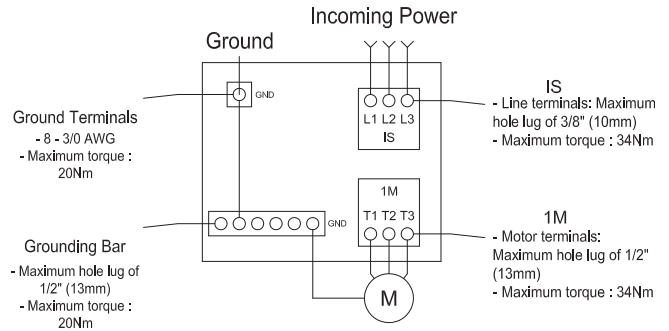

Network Connection (VMB1)


Shielded Female Connector RJ45

Modbus TCP/IP




Control Terminals (I/O board)

Terminals Wire Size:
24 - 12 AWG
0.5 Nm

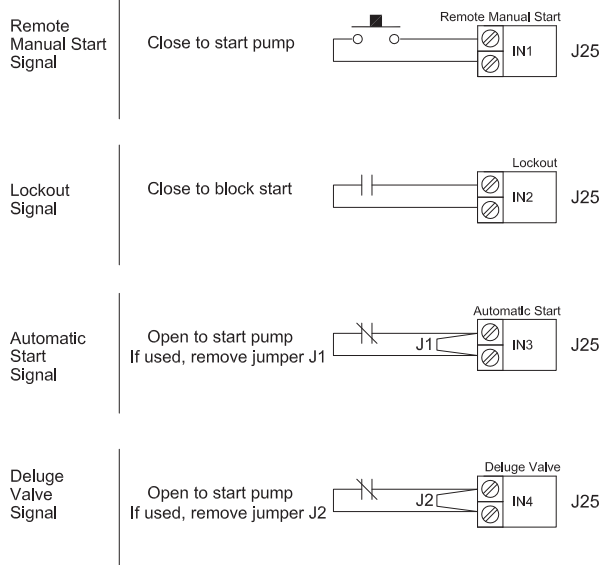



Alarms Inputs (I/O board)

Terminals Wire Size:
24 - 12 AWG
0.5 Nm



Drawing for information only.
Manufacturer reserves the right to modify this drawing without notice.
For drawing for approval or installation, please contact manufacturer.

 THIRD ANGLE PROJECTION	SIZE	A	BY	DATE	 Firetrol, Inc. © Firetrol, Inc. Not for construction. Subject to change without notice.	REVISED TO CURRENT MANUFACTURING				A	-	TEF	TEF	5-28-21
	DRAWN BY	CIR	11-5-19			REVISION DESCRIPTION				REV	ECN NO	BY	APP	DATE
	FINAL APPROVAL	CIR	11-5-19			FIELD CONNECTIONS		FTA2000		DRAWING NUMBER				
						5/7KV ELECTRIC FIRE PUMP CONTROLLER				WS2000-30				
										DWG REV	A	ECN NO	-	SHEET 1 OF 1

All rights reserved. The drawing and the information contained or depicted herein are the sole property of Firetrol, Inc. Copies are communicated to the recipient in strict confidence and may not be retransmitted, published, reproduced, copied or used in any manner, including as the basis for the manufacture or sale of any products, without the express prior written consent of Firetrol, Inc.