© Firetrol, Not for construction.
Subject to change without notice.

	BY	DD/MM/YY
DRAWN BY	DDS	27/05/26
FINAL APPROVAL	FC	27/05/26

ELECTRIC FIRE PUMP CONTROLLER WITH UL LISTED DISCONNECTING MEANS FOR ELECTRIC FIRE PUMP APPLICATIONS

MODEL:FTA1000+FTA990

BUILT TO THE LATEST EDITION OF THE NFPA20 & NFPA70

NYC Dpt of Building Approved

THIRD ANGLE PROJECTION

DRAWING NUMBER DD-P2D-200/E

DWG REV. 0

SHEET 1 OF 1

Option P2D:
OPD for Normal power mounted on the right side and electrically connected

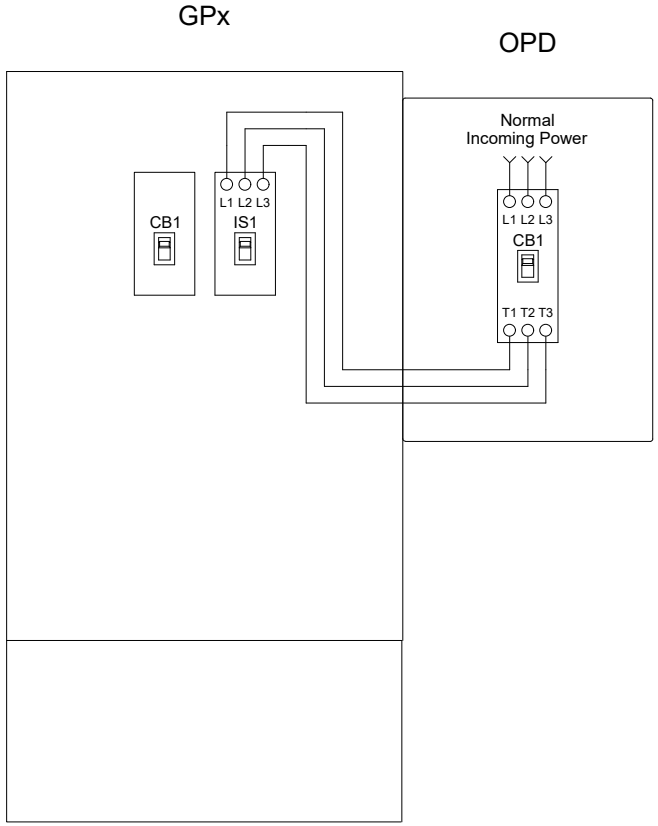

Copyright © 2026 Firetrol All right reserved. This drawing and the information contained or depicted herein are the sole property of Firetrol Copies are communicated to the recipient in strict confidence and may not be retransmitted, published, reproduced, copied or used in any manner, including as the basis for the manufacture or sale of any products, without the express prior written consent of Firetrol