




**Remote Alarm Panels For Use With Electric and Diesel Engine Fire Pump Controllers**

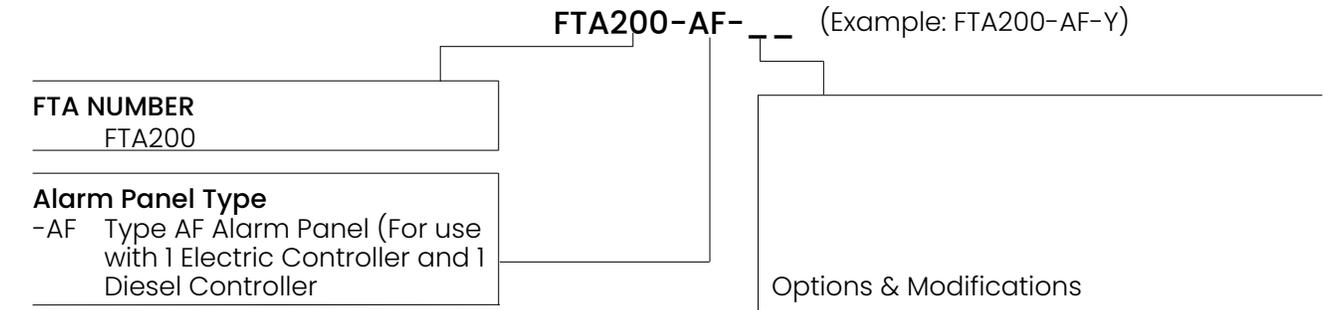

**SPECIAL ENCLOSURES**

Option	Description
---	Enclosure, NEMA Type 1 (IP20), Painted Steel
-Q	Enclosure, NEMA Type 2 (IP22), Painted Steel
-EX	Enclosure, NEMA Type 4 (IP66), Painted Steel
-F	Enclosure, NEMA Type 4X (IP66), #304 Stainless Steel, Brushed Finish
-FXP	Enclosure, NEMA Type 4X (IP66), #304 Stainless Steel, Painted Finish

**Optional Alarms - ELECTRIC**

Option	Description
-AM	Alarm, Audible/Visible, Fail To Start
-BYI	Alarm, Audible/Visible, Overcurrent
-EJI	Alarm, Audible/Visible, Flow Meter Open
-Y	Alarm, Specify Number Of Alarms, Function of Each & Nameplate Marking

**Optional Alarms - DIESEL**

Option	Description
-AV	Alarm, Audible/Visible, Low Pump Room Temperature
-AW	Alarm, Audible/Visible, Reservoir Low
-AYI	Configurable Low Suction Pressure Visible/Output Contacts with External Digital Input
-AK	Alarm, Audible/Visible, Low Oil Pressure
-AL	Alarm, Audible/Visible, High Water Temperature
-AM	Alarm, Audible/Visible, Fail To Start
-API	Alarm, Audible/Visible, Main Switch In Manual
-AR	Alarm, Audible/Visible, Main Switch In Off
-ASI	Alarm, Audible/Visible, Main Switch In Auto
-BTC	Alarm Output Contacts, Charger #1 & #2 Failure (Form-C, SPDT)
-CFC	Alarm Output Contacts, Battery #1 & #2 Failure (Form-C, SPDT)
-LC	Alarm, Audible/Visible, High Fuel Level
-LEI	Alarm, Audible/Visible, Fuel Spill
-Y	Alarm, Specify Number Of Alarms, Function of Each & Nameplate Marking

Miscellaneous  
Description

Option

---

-BA	AC Input, 220-240V
-BS	Fire Pump Start Push-button

---

**INFORMATION REQUIRED WITH ORDER**

- 1) Catalog number of alarm panel.
- 2) Catalog number of controller to be used with alarm panel.
- 3) Modifications if any.

***Firetrol, Inc.***

3412 Apex Peakway  
Apex, North Carolina 27502  
P +1 919 460 5200  
F +1 919 460 5250  
[www.firetrol.com](http://www.firetrol.com)

While every precaution has been taken to ensure accuracy and completeness herein, Firetrol, Inc. assumes no responsibility, and disclaims all liability, for damages resulting from use of this information or for any errors or omissions. Specifications and drawings are subject to change without notice. ©2019 Firetrol, Inc., All Rights Reserved.

**Publication SD200-62 Rev. B**