




# Model Number Selection Guide

## FTA2000

Mark IIx6 Electric Fire Pump Controllers

Medium Voltage Across The Line Starting

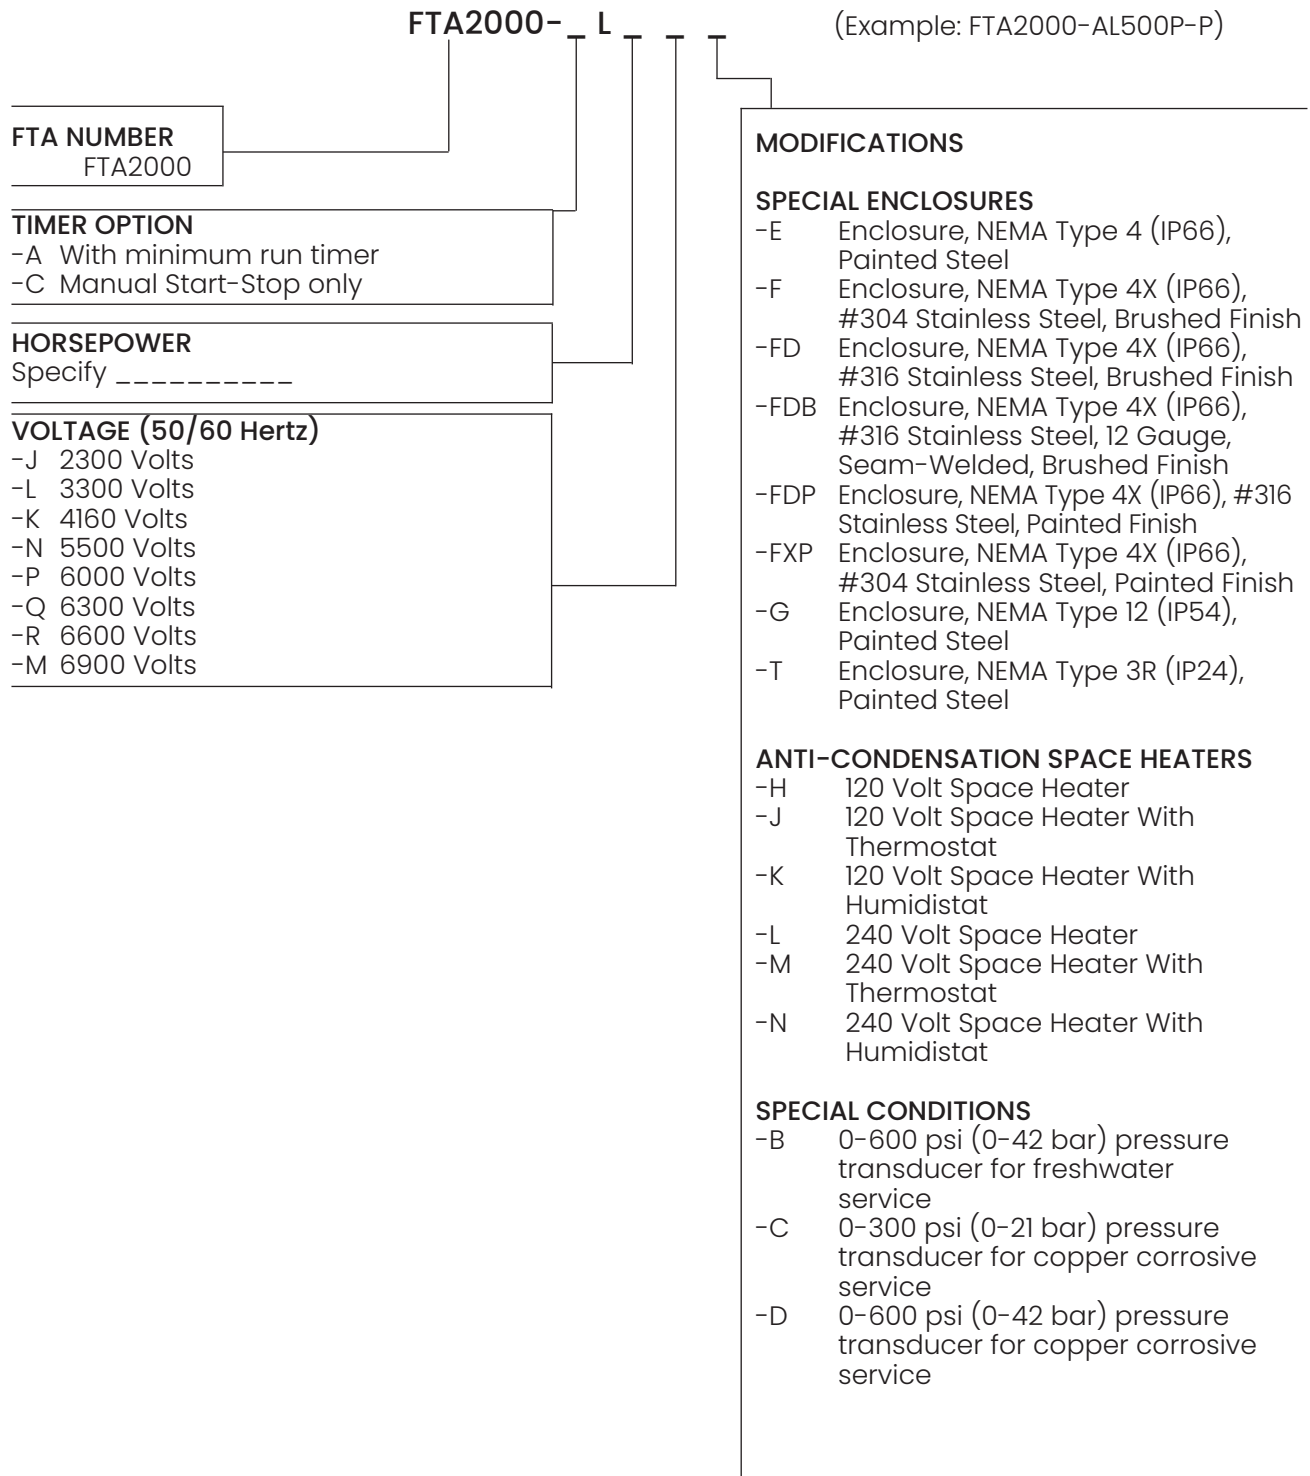

*Continued on other side*

## Model Number Selection Guide – Options & Modifications

### ALARMS

- AC Extra contacts (normally open & normally closed) for remote indication, pump operating
- AF Audible and Visible low pump room temperature alarm
- AG Audible and Visible reservoir low alarm
- AH Audible and Visible low suction pressure alarm
- AM Contacts for remote indication, pump fail to start
- AV Contacts for remote indication, low pump room temperature (Requires option -AF)
- AW Contacts for remote indication, reservoir low (Requires option -AG)
- AY Contacts for remote indication, low suction pressure (Requires option -AH)
- AZ Low pump room temperature switch, mounted and wired
- BW Extra contacts for remote indication, phase failure/phase reversal
- BY Contacts for remote indication, pump overload
- COM Low suction pressure alarm, (Includes selectable auto/manual reset, audible, visible and remote alarms, initiating pressure switch not included)
- CTS Built in Low Suction Pressure Alarm Panel (Includes selectable auto/manual reset, audible, visible and remote alarms and mounted and wired pressure switch)
- EG Audible and Visible relief valve discharge alarm
- EH Contacts for remote indication, relief valve discharge (Requires option -EG)
- EJ Audible and Visible flow meter on alarm
- EK Contacts for remote indication, flow meter on (Requires option -EJ)
- KH Contacts for remote indication, common output for any alarm
- JR Visible jockey pump running indication
- JT Audible and Visible jockey pump trouble indication
- P Built-in alarm system (Includes visible supervisory voltage normal indication and audible pump operating, phase failure and phase reversal indication)
- PE Contacts for remote indication, low system pressure
- PT Built-in alarm system, 220 VAC supervisory power (Includes visible supervisory voltage normal indication and audible pump operating, phase failure and phase reversal indication)

### MISCELLANEOUS

- BAT 220-240 Volt Test Circuit
- GZ 50 Hz Operation
- IECI CE Marking (Internal (enclosed) wet parts) (Requires NEMA Type 12 (IP54) Enclosure as a minimum)
- PY Motor space heater output contacts
- S Tropicalization
- SEI Seismic Certification (in accordance with IBC)
- USBX External USB Port
- ZPA Customized, annual service display message (factory programmed)
- ZPN Serial Modbus RTU over ethernet TCP/IP using 5150 connectivity module
- ZPM Serial Modbus RTU over 2-wire or 4-wire RS485

\*Weekly Test Timer – Standard

### **Firetrol, Inc.**

3412 Apex Peakway  
Apex, North Carolina 27502  
P +1 919 460 5200  
F +1 919 460 5250  
www.firetrol.com

*While every precaution has been taken to ensure accuracy and completeness herein, Firetrol, Inc. assumes no responsibility, and disclaims all liability, for damages resulting from use of this information or for any errors or omissions. Specifications and drawings are subject to change without notice. ©2019 Firetrol, Inc., All Rights Reserved.*

**Publication SD2000-50 Rev. K**