


MARK^{III} Medium Voltage Electric Fire Pump Controllers – Across The Line Starting

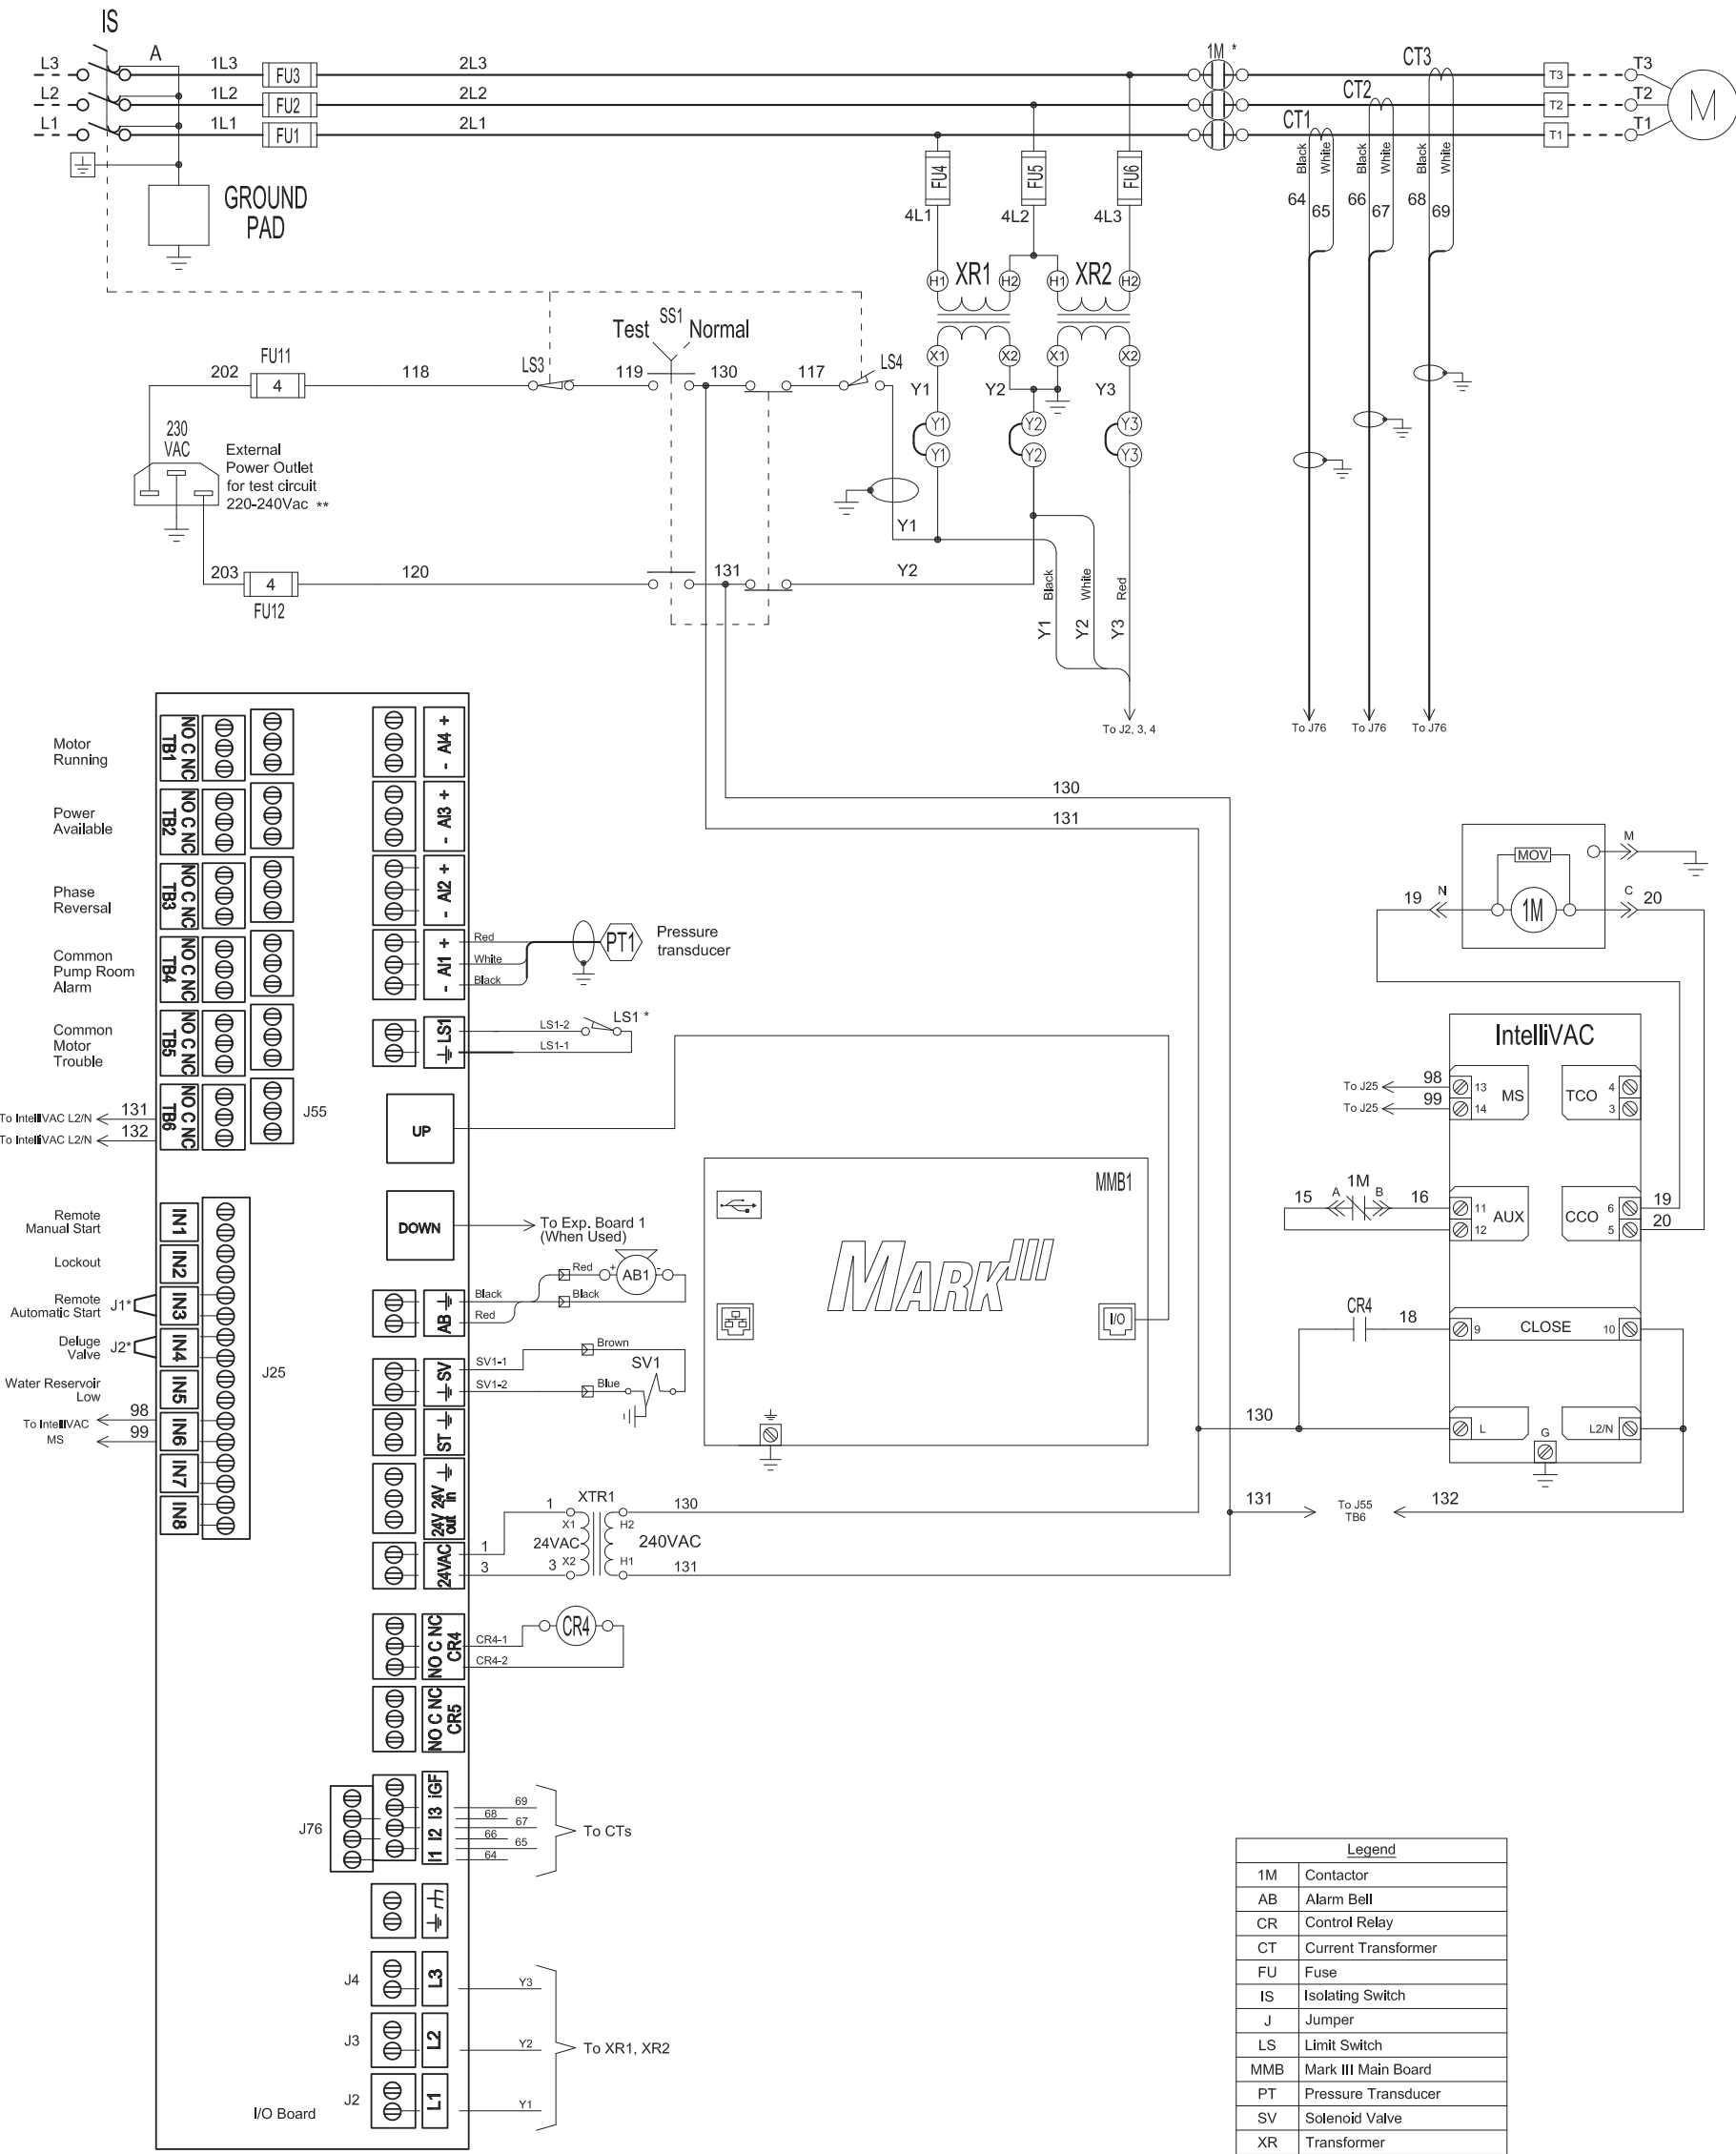

Drawing for information only.
Manufacturer reserves the right to modify this
drawing without notice.
For drawing for approval or installation, please
contact manufacturer.

* Contact closed when Emergency Start is in ON position
** For 110-120Vac Test Circuit order Controller option -Y231

	SIZE	B	BY	DATE
	DRAWN BY	JMW	12-2-19	
	FINAL APPROVAL	CIR	12-2-19	

Firetrol, Inc.
© Firetrol, Inc. Not for construction.
Subject to change without notice.

REVISED TEST CIRCUIT		B	-	TEF	TEF	05/28/21
ADDED CHART		A	-	CIR	CIR	2-18-20
REVISION DESCRIPTION		REV	ECN NO	BY	APP	DATE
WIRING SCHEMATIC		FTA2000				
5/7.2KV CLASS ELECTRIC FIRE PUMP CONTROLLER		DRAWING NUMBER		WS2000-30		
		DWG REV		ECN NO	SHEET 1 OF 1	
		B		-		

All rights reserved. The drawing and the information contained or depicted herein are the sole property of Firetrol, Inc. Copies are communicated to the recipient in strict confidence and may not be retransmitted, published, reproduced, copied or used in any manner, including as the basis for the manufacture or sale of any products, without the express prior written consent of Firetrol, Inc.