
Wiring Schematic Option & Modifications




Jockeyxg Pump Controllers - Wye-Delta Open Transition Starting with C.B.





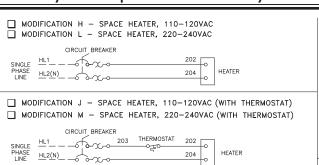


☐ MODIFICATION AC - PUMP OPERATING ALARM CONTACTS




☐ MODIFICATION BY - PUMP OVERLOAD REMOTE ALARM CONTACT




☐ MODIFICATION NZ - INTERLOCK SHUTDOWN IN AUTO



■ MODIFICATION AST - REMOTE AUTO START INPUT



WIRING REQUIRED WHEN JPXG OPTION BOARD IS USED



NOTE:

 $\Rightarrow \oplus$

THIRD ANGLE PROJECTION

TERMINAL NUMBERS SUBJECT TO CHANGE


06-05-13

TEF




MODIFICATION AM - PUMP FAILED TO START REMOTE ALARM CONTACTS JPXG OPTION BOARD I TB704 1 2 3 NORMALLY OPEN, CLOSES TO ALARM TO ALARM OPEN OPENS TO ALARM TO ALARM


$\hfill \square$ Modification ef - switch not in auto remote alarm contacts



☐ MODIFICATION KH - COMMON TROUBLE REMOTE ALARM CONTACTS



☐ MODIFICATION BW - PHASE FAILURE/REVERSAL REMOTE ALARM CONTACTS



CONTROL AND ALARM TERMINAL WIRE CAPACITY	
JPXG OPTION BOARD TERMINALS	#18-12 AWG [.75-4 MM ²]
PUMP OPERATING TERMINALS	#14-12 AWG [2.5-4 MM ²]
CIRCUIT BREAKERS	#14-4 AWG [2.5-25 MM ²]